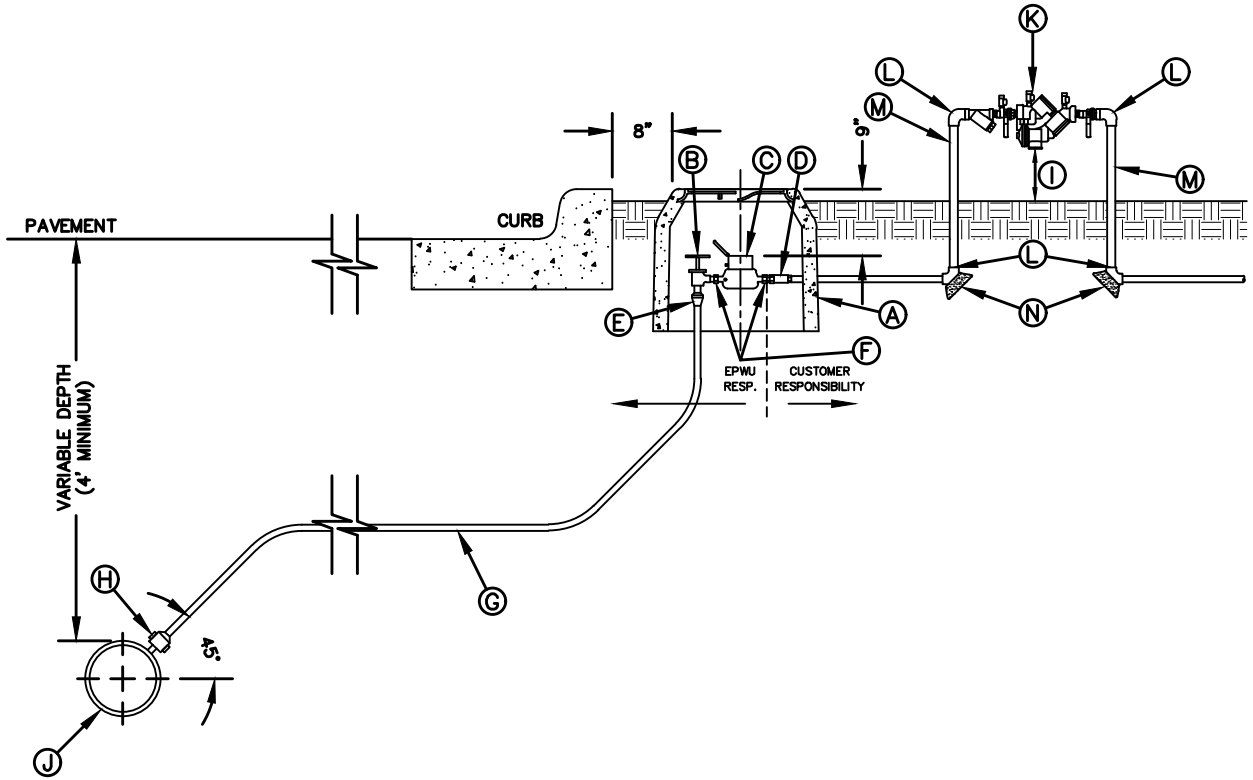

GENERAL NOTES:

1. DETAIL SHOWN FOR A 3/4" SERVICE, 1" SERVICE INSTALLATION IS SIMILAR EXCEPT FOR SIZES OF PIPE, FITTING, METER AND BOX (TYPE "B").
2. WHERE NO CURB EXISTS, METER IS TO BE SET NEAR PROPERTY LINE OR AT DESIGNATED LOCATION.
3. THE EPWU WILL FURNISH AND INSTALL ALL NECESSARY PIPE, FITTINGS, METER BOXES, AND METERS REQUIRED. IT SHALL BE THE RESPONSIBILITY OF THE PRIVATE OWNER TO HAVE A CERTIFIED PLUMBER INSTALL A BACKFLOW PREVENTER AND EXTEND SERVICE LINE ON DISCHARGE SIDE OF METER.

CONSTRUCTION KEY NOTES:

A. METER BOX TYPE "A" (SEE DETAILS 291 & 292) SHALL BE SET SLIGHTLY HIGHER THAN SURROUNDING GROUND OR AT CURB LEVEL.
B. 3/4" BALL ANGLE SERVICE VALVE WITH PADLOCK WINGS.
C. WATER METER (CENTER INSIDE METER BOX).
D. WHEN REQUIRED BY EPWU, A DUAL CHECK BACKFLOW PREVENTER SHALL BE INSTALLED ON THE OUTLET SIDE OF THE METER.
E. END FLARE OF SERVICE LINE.
F. INLET AND OUTLET COUPLING.
G. 3/4" COPPER SERVICE LINE.
H. 5/8" X 3/4" CORPORATION STOP.
I. 12" MIN. – 36" MAX.
J. WATER MAIN.
K. 3/4" BACKFLOW PREVENTER WHEN REQUIRED BY EPWU.
L. 3/4" FEMALE THREADED 90° ELBOW.
M. 3/4" BRASS PIPE–LENGTH AS REQUIRED.
N. THRUST BLOCKING AS REQUIRED.

STANDARD DETAIL	DATE: 10/20/2000 REV: 1/28/2022	SERVICE LINE 3/4" AND 1" INSTALLATION BY EPWU	N.T.S.	el paso WATER	DETAIL No. 290–1